

1421

Gate valves
Flexible wedge
Bellow sealed
PN 10-25 DN 50-300

Design
 Acc. to DIN 3352

Top part
 Outside screw
 Non-rising handwheel
 Rising stem

Stem sealing
 Bellow with additional
 Stuffing box


Obturator
 Flexible wedge

Body seat
 Integral seats

Valve ends
 Flanges acc. to
 EN 1092-1 (DIN 2501
 Part 1)

Requirements and tests
 Acc. to DIN 3352 Part 1

Marking
 Nominal size DN
 Nominal pressure PN
 Body material
 Manufacturer brand

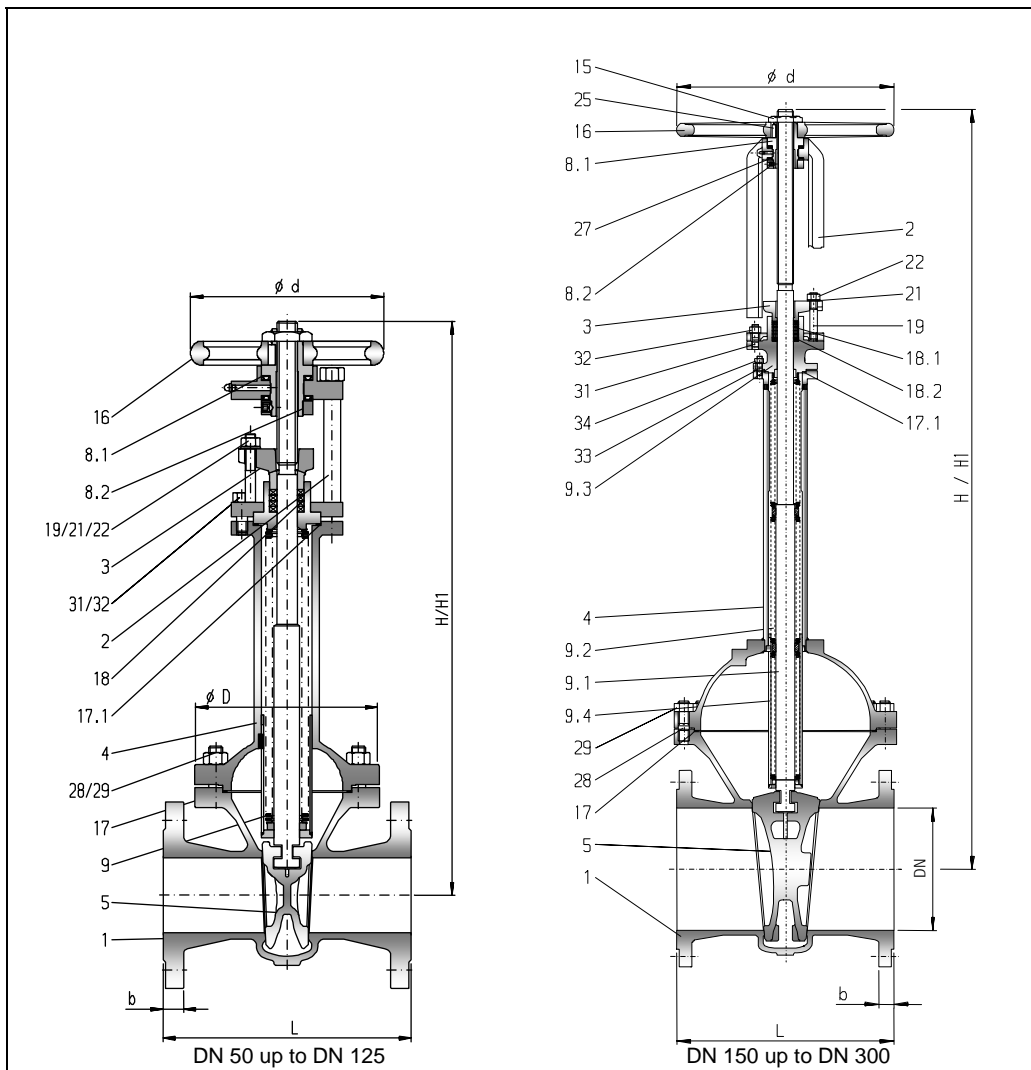

Pos.	Denomination	Material		Pos.	Denomination	Material	
		1.4308	1.4408			1.4308	1.4408
1	Body	1.4308	1.4408	17	Gasket (grooved)	1.4541 / Graphite	1.4571 / Graphite
2	Yoke	1.4308	1.4408	18	Packing	Graphite	Graphite
3	Gland	1.4541	1.4571	19	Stud bolt	A2-70	A4-70
4	Bonnet	1.4308 / 1.4541	1.4408 / 1.4571	21	Washer	1.4541	1.4571
5	Wedge	1.4308	1.4408	22	Hex. Nut	A2	A4
8.1	Sleeve	0.7040	0.7040	27	Bearing	Cr.-steel	Cr.-steel
8.2	Threaded ring	1.4021	1.4021	28	Stud bolt	A2-70	A4-70
9.1	Stem	1.4541	1.4571	29	Hex. Nut	A2	A4
9.2	Bellow	1.4571	1.4571	31	Stud bolt	A2-70	A4-70
9.3	Gland housing	1.4541	1.4571	32	Hex. Nut	A2	A4
9.4	Guide tube	1.4541	1.4571	33	Stud bolt	A2-70	A4-70
15	Retaining nut	Steel, zinc-coated		34	Hex. nut	A2	A4
16	Handwheel	Steel	Steel				

¹ further materials are shown in the technical part

Face-to-face dimensions acc. to EN 558-1 series 15 (DIN 3202-F5)

DN	50	65	80	100	125	150	200	250	300	
L	250	270	280	300	325	350	400	450	500	
H	520		630	695	800	1100			1890	
H1	580		730	815	940	1275			2225	
Ø d	200	225	225	320	360	400	400	500	500	
Ø D	178	182	215	255	272	315	365	440	515	
PN 10	b	18	18	20	20	22	22	24	26	28
PN 16	b	20	18	20	20	22	22	24	26	28
PN 25	b	20	22	24	24	26	28	30	32	34

Pressure/Temperature ratings in bar g at Temperature in °C

Material	PN	50°C	120°C	150°C	200°C	250°C	300°C						
»1.4308« GX5CrNi19-10 EN 10213	10	10,0	7,7	6,7	5,7	5,2	4,8						
	16	16,0	12,3	10,7	9,1	8,4	7,7						
	25	25,0	19,2	16,7	14,2	13,1	12,1						
»1.4408« GX6CrNiMo18-10-2 EN 10213	10	10,0	8,2	7,2	6,2	5,7	5,1						
	16	16,0	13,2	11,6	10,0	9,1	8,2						
	25	25,0	20,7	18,1	15,7	14,2	12,8						

Modifications

Position indicator
Butt-welding ends
Pressure relief
By-pass tube

Additional equipment

Chain wheel
Stem extension
Gear
Electric actuator

Installation

Piping is to be in such a manner that injurious thrust and bending forces are kept away from the valve casings. Gate valves are usually installed with vertical stem position. Gate valves can also be installed in pipelines with changing flow directions. If in the closed position the medium between the obturator and the middle area of the body can be heated up, the user has to check if a cavity pressure relief must be used. In this case e.g. a relief valve will be installed via tube to the inlet side of the gate valve (defined flow direction). When turning the handwheel it is not allowed to use additional levers.